

ENGINEERING STANDARD


OAK RIDGE TENNESSEE

NUMBER	ES-5.12-7
DATE	8-3-84
REVISED	
PAGE	1 of 1

FIRE DAMPER - FLOOR BARRIER - FRAME MOUNTED

NOTES

- ALL FIRE DAMPER INSTALLATIONS SHALL BE INSPECTED AND APPROVED BY FIRE DEPARTMENT. DAMPER, OPERATION AND INSTALLATION SHALL BE IN ACCORDANCE WITH NFPA STANDARD 90A.

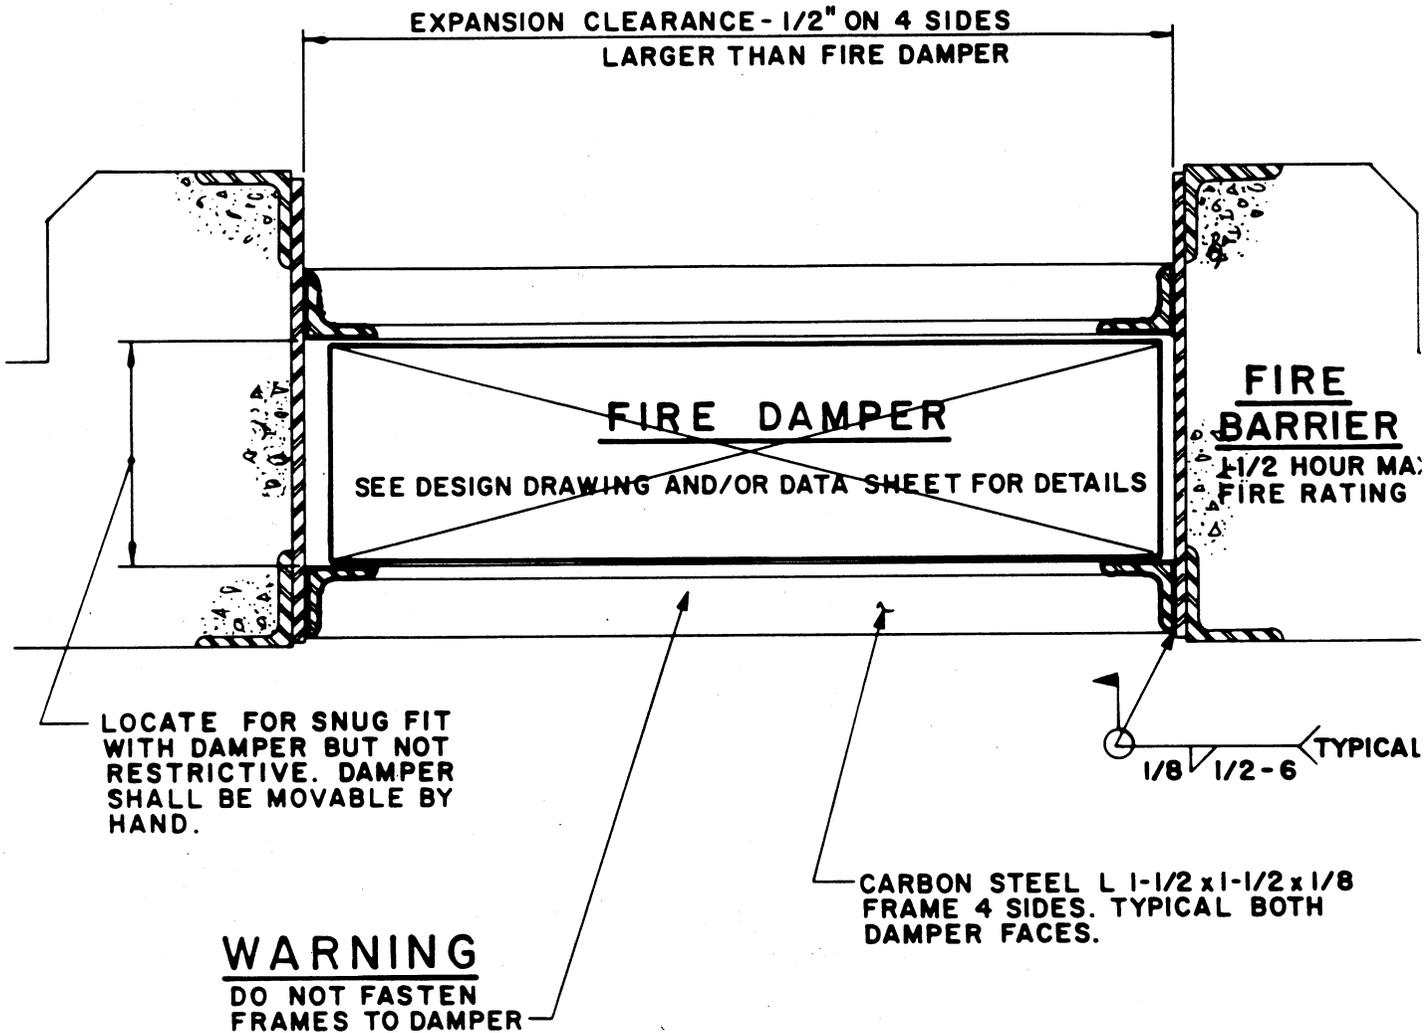

APPROVED BY *W. E. Weatherly*

NUMBER ES-5.12-7